


### OUTLINE DIMENSION

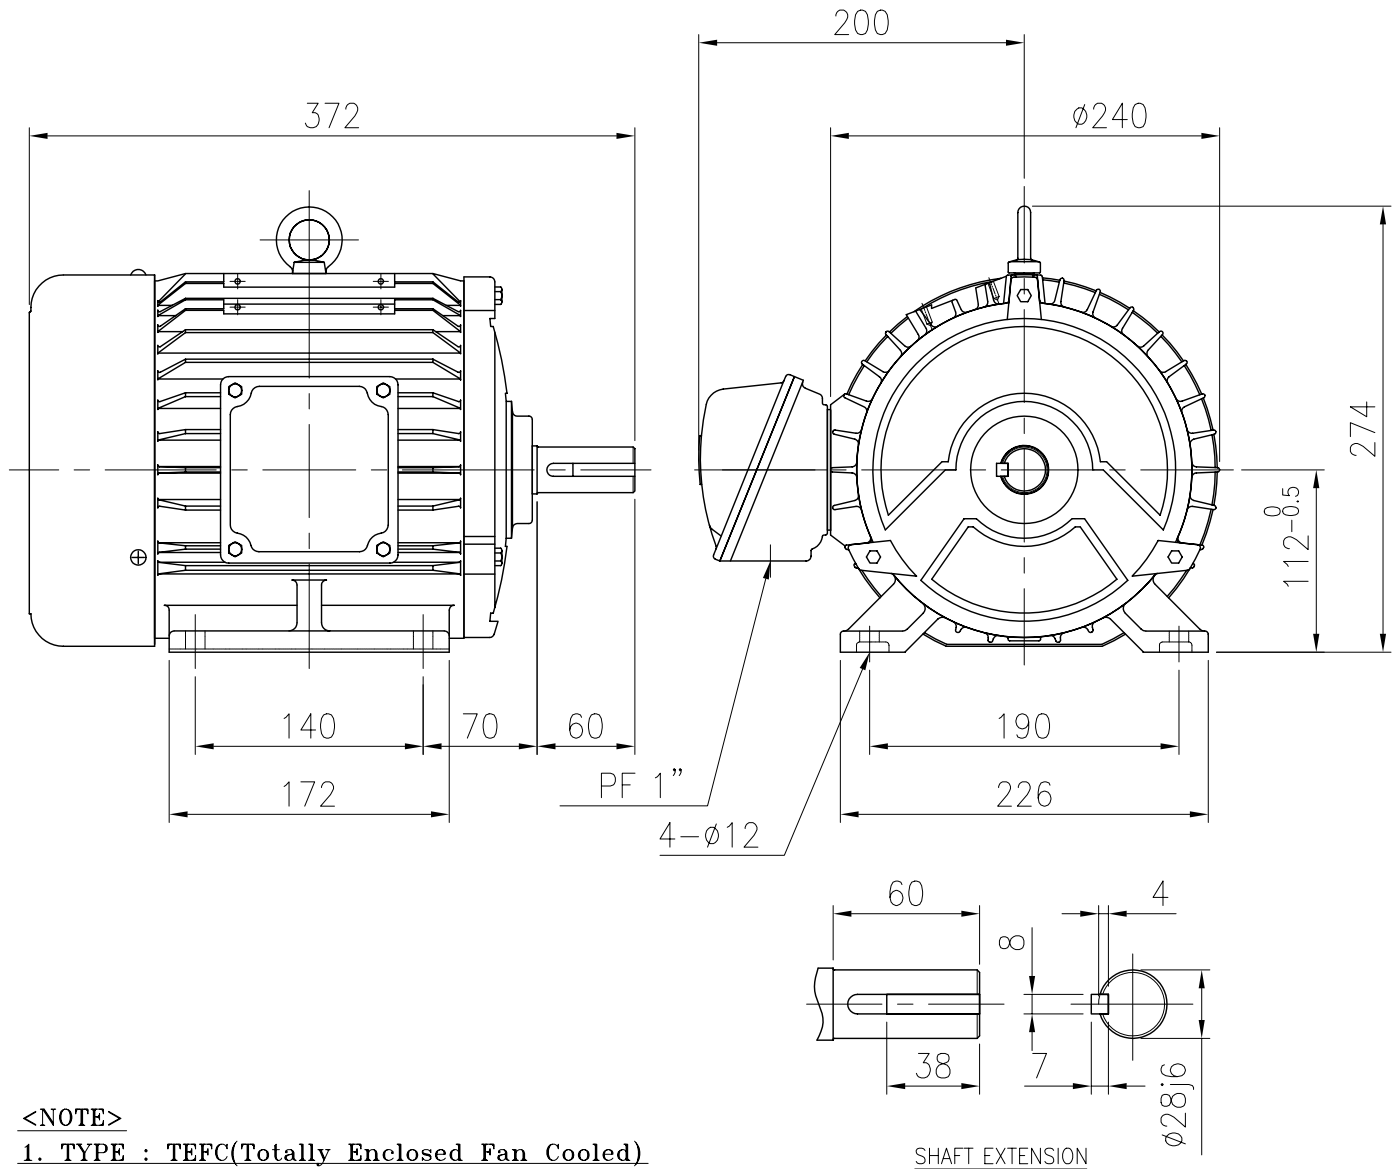

#### <NOTE>

1. TYPE : TEFC(Totally Enclosed Fan Cooled)  
FOOT MOUNTED TYPE
2. THE TOLERANCE FOR THE KEY DIMENSIONS  
IS IN ACCORDANCE WITH KS B 1311-84
3. THE TERMINAL BOX MAY BE ROTATED  
STEPS OF 90°

4. CAST IRON FRAME AND END BRACKETS.
5. STAINLESS STEEL NAME PLATE WITH  
CONNECTION DIAGRAM.
6. STEEL FAN COVER AND CAST IRON TERMINAL BOX.

| FRAME NO. | OUTPUT (kW) |     |    |    | INS. CLASS | PRO-TEC-TION | RA-TING | BEARING NO. |        |        |        |         |        | APPROX. WEIGHT (Kg) |    |       |
|-----------|-------------|-----|----|----|------------|--------------|---------|-------------|--------|--------|--------|---------|--------|---------------------|----|-------|
|           | 2P          | 4P  | 6P | 8P |            |              |         | 2 P         |        | 4 P    |        | 6P / 8P |        | 2P                  | 4P | 6P/8P |
|           |             |     |    |    |            |              |         | DRIVE       | OPP.D. | DRIVE  | OPP.D. | DRIVE   | OPP.D. |                     |    |       |
| 112M      | —           | 3.7 | —  | —  | F          | IP44         | CONT    | —           | —      | 6206ZZ | 6205ZZ | —       | —      | —                   | 42 | —     |

| UNIT                   | mm | SCALE                | N<br>S | PROJECT'N             | 3rd Angle | TITLE    | OUTLINE      |
|------------------------|----|----------------------|--------|-----------------------|-----------|----------|--------------|
| DESIGNED               |    | CHECKED              |        | APPROVED              |           |          |              |
| 2007.09.07<br>M.S.PARK |    | 2007.09.07<br>J.H.JO |        | 2007.09.07<br>H.J.KIM |           | SUBJECT  | 112M, B3     |
| Otis Elevator Korea    |    |                      |        |                       |           | DWG. NO. | DW-KME-05HV1 |